


PNEUMATIC POSITIVE POSITIONER CONNECTION AND ADJUSTMENT INSTRUCTIONS

CW = Decrease
Start PSI

START ADJ
Brass Screw
Under Cover

D9502-5
POSITIVE POSITIONER

Use D9502-512
Spring for D-3246
Actuator

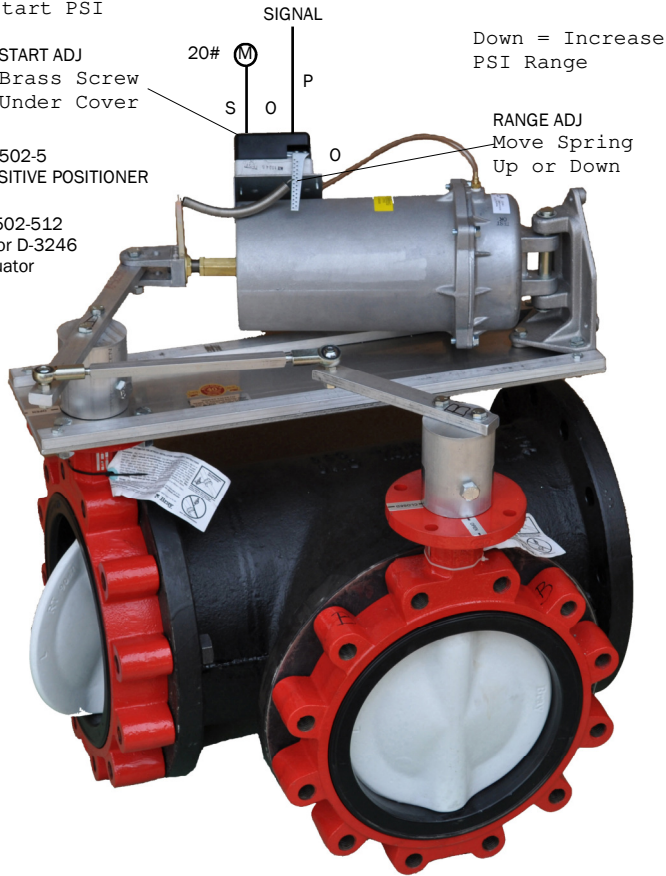

**JOHNSON
CONTROLS**




RANGE DETERMINED
BY SPRING SELECTION
ORG---3 PSI
YEL---5 PSI
BLU---10 PSI

14004264-001
POSITIVE POSITIONER
& 14004210-001
SPRING RANGE KIT

START
ADJ DIAL

M 20#
P SIGNAL
B

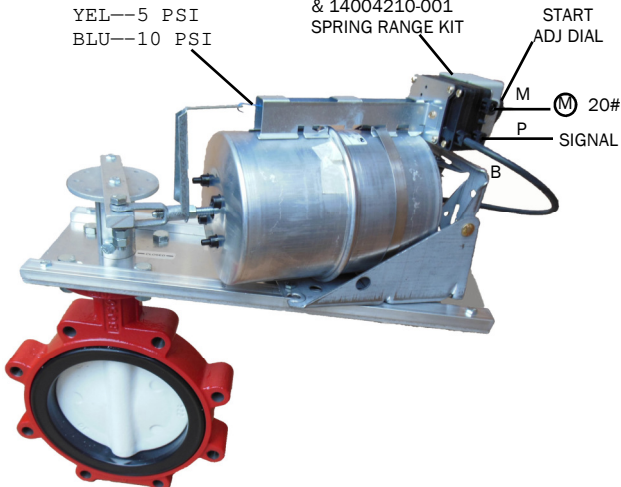

HONEYWELL


AK42309-500
POSITIVE POSITIONER

START ADJ

SIGNAL

RANGE ADJ

Select Correct Spring
for Respective Actuator

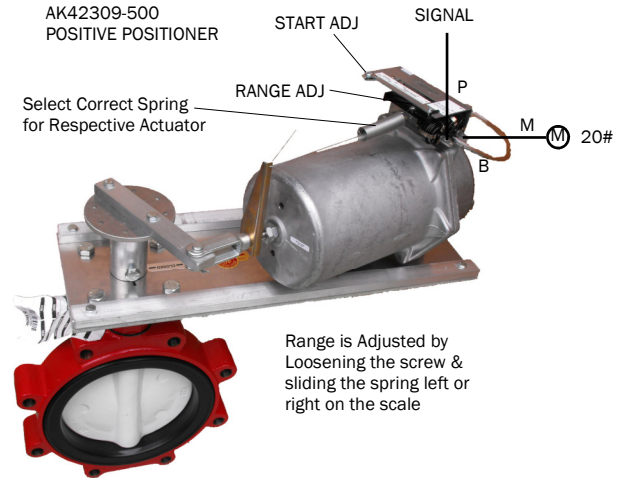

Range is Adjusted by
Loosening the screw &
sliding the spring left or
right on the scale

**Schneider
Electric**

START ADJ
Brass Screw
Under Cover &
Down in Hole

RANGE ADJ
Move Spring
Up or Down

SIGNAL


20# M

S

M

Pos Positioner
M Connects to
the Actuator

147-2000 POSITIVE
POSITIONER & 147-276
MOUNTING KIT
USE 147-314
MOUNTING KIT ON
SMALLER ACTUATOR

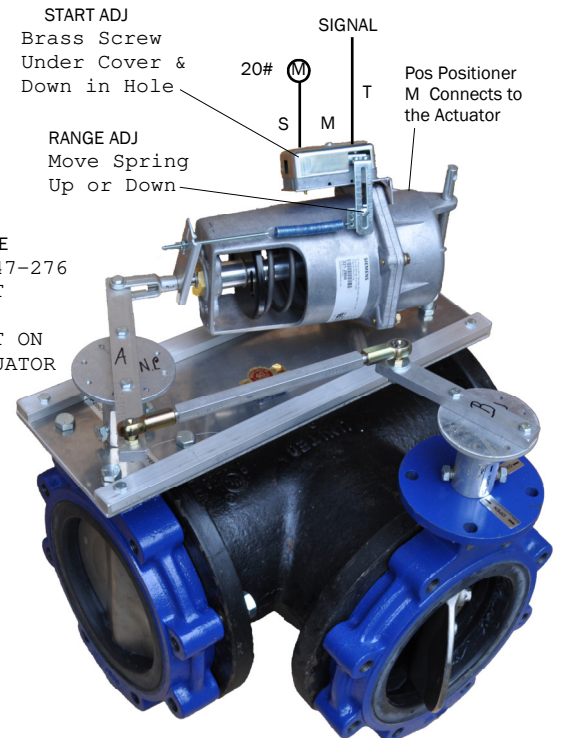

SIEMENS



WESLEY VALVE CO.

MFGRS OF AUTOMATED BUTTERFLY VALVES
3229 North L Street
Pensacola, FL 32505
PHN: (404) 351-8744 FAX: (404) 351-9340

WWW.WESLEYVALVE.COM